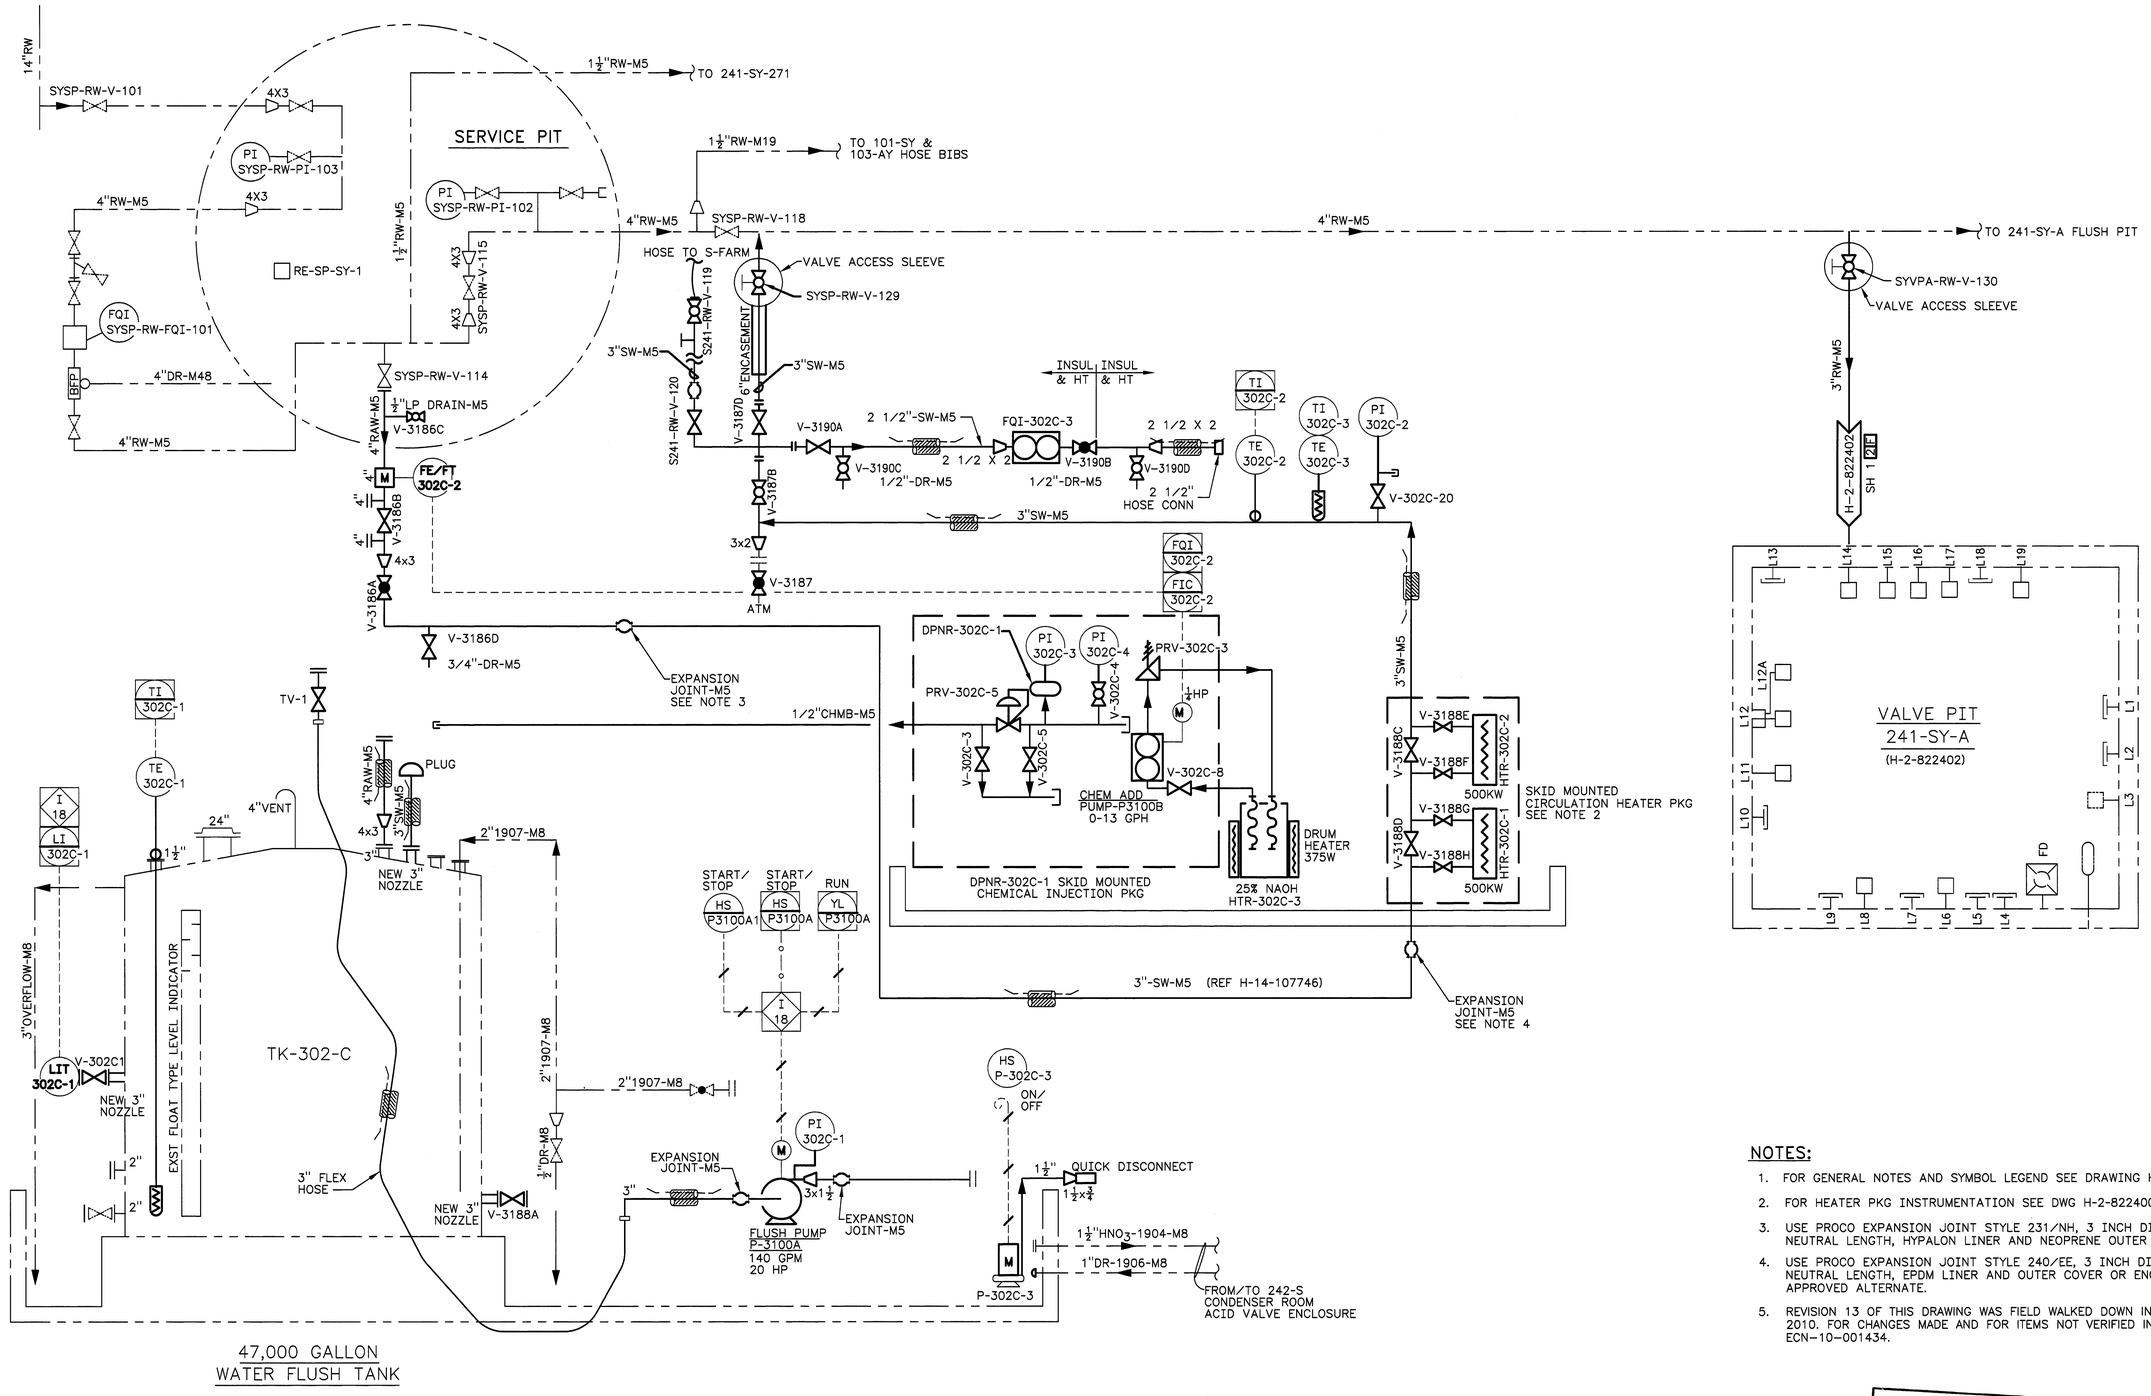

NOTES:

1. FOR GENERAL NOTES AND SYMBOL LEGEND SEE DRAWING H-14-020000.
2. FOR HEATER PKG INSTRUMENTATION SEE DWG H-2-822400,SH1.
3. USE PROCO EXPANSION JOINT STYLE 231/NH, 3 INCH DIA, 6 INCH NEUTRAL LENGTH, HYPALON LINER AND NEOPRENE OUTER COVER
4. USE PROCO EXPANSION JOINT STYLE 240/EE, 3 INCH DIA, 6 INCH NEUTRAL LENGTH, EPDM LINER AND OUTER COVER OR ENGINEERING APPROVED ALTERNATE.
5. REVISION 13 OF THIS DRAWING WAS FIELD WALKED DOWN IN NOVEMBER 2010. FOR CHANGES MADE AND FOR ITEMS NOT VERIFIED IN FIELD, SEE ECN-10-001434.

MAR 08 2011 DATE: STA: 4 HANFORD RELEASE ID: 11

DWG NO	TITLE
H-2-46540	EFD ACID STORAGE & XFER
H-2-37757 SH2	INSTM ENGRG FLOW DIAG SY TANKS 101 & 102
H-14-020000	TK FARMS SYS P&ID DWG LEGEND
H-2-822200	DRAWING LIST

DRAWING TRACEABILITY LIST

REFERENCES

NEXT USED ON H-2-822403

REV REL	REV NO	DESCRIPTION	REV BY DATE	DRAFTING APRVD	ENGR COMPANY
S	RS 15	DIRECT REV PER ECN-10-001434	DAM 11/10	RN KYLE	

REVISIONS

NAME / DATE / COMPANY — DRAWN BY: SEE REVISION 0 — ENGINEER

U.S. DEPARTMENT OF ENERGY
Office of River Protection

P & I D
WATER FLUSH SYSTEM

SIZE F | BLDG NO 241S | INDEX NO 7004 | DWG NO H-2-822409 | REV 15

SCALE | EDT | SHEET 1 OF 1

29078 DOE_TB_F.DWG (01-01)

DWG NO H-2-822409 SH 1 OF 1 REV 15