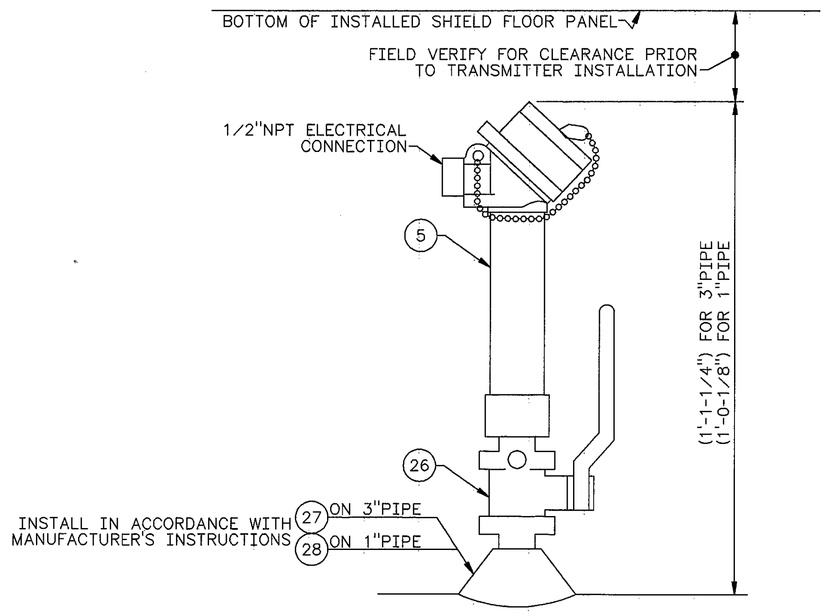

PRESSURE TRANSMITTER

SCALE: NONE

PT 3125A, 3125B, 3125C, 3125D, 3125E, 3173, 3182, 3183 (SEE H-2-822336, SH 1)
PT 3126A, 3126B, 3167, 3168, 3185 (SEE H-6-13994, SH 1)

NOTE: PERFORM LEAK TEST IN ACCORDANCE WITH GAS AND BUBBLE TEST METHOD SPECIFIED IN BPV CODE, SECT V, ARTICLE 10. TEST PRESSURE SHALL BE 15 PSIG.

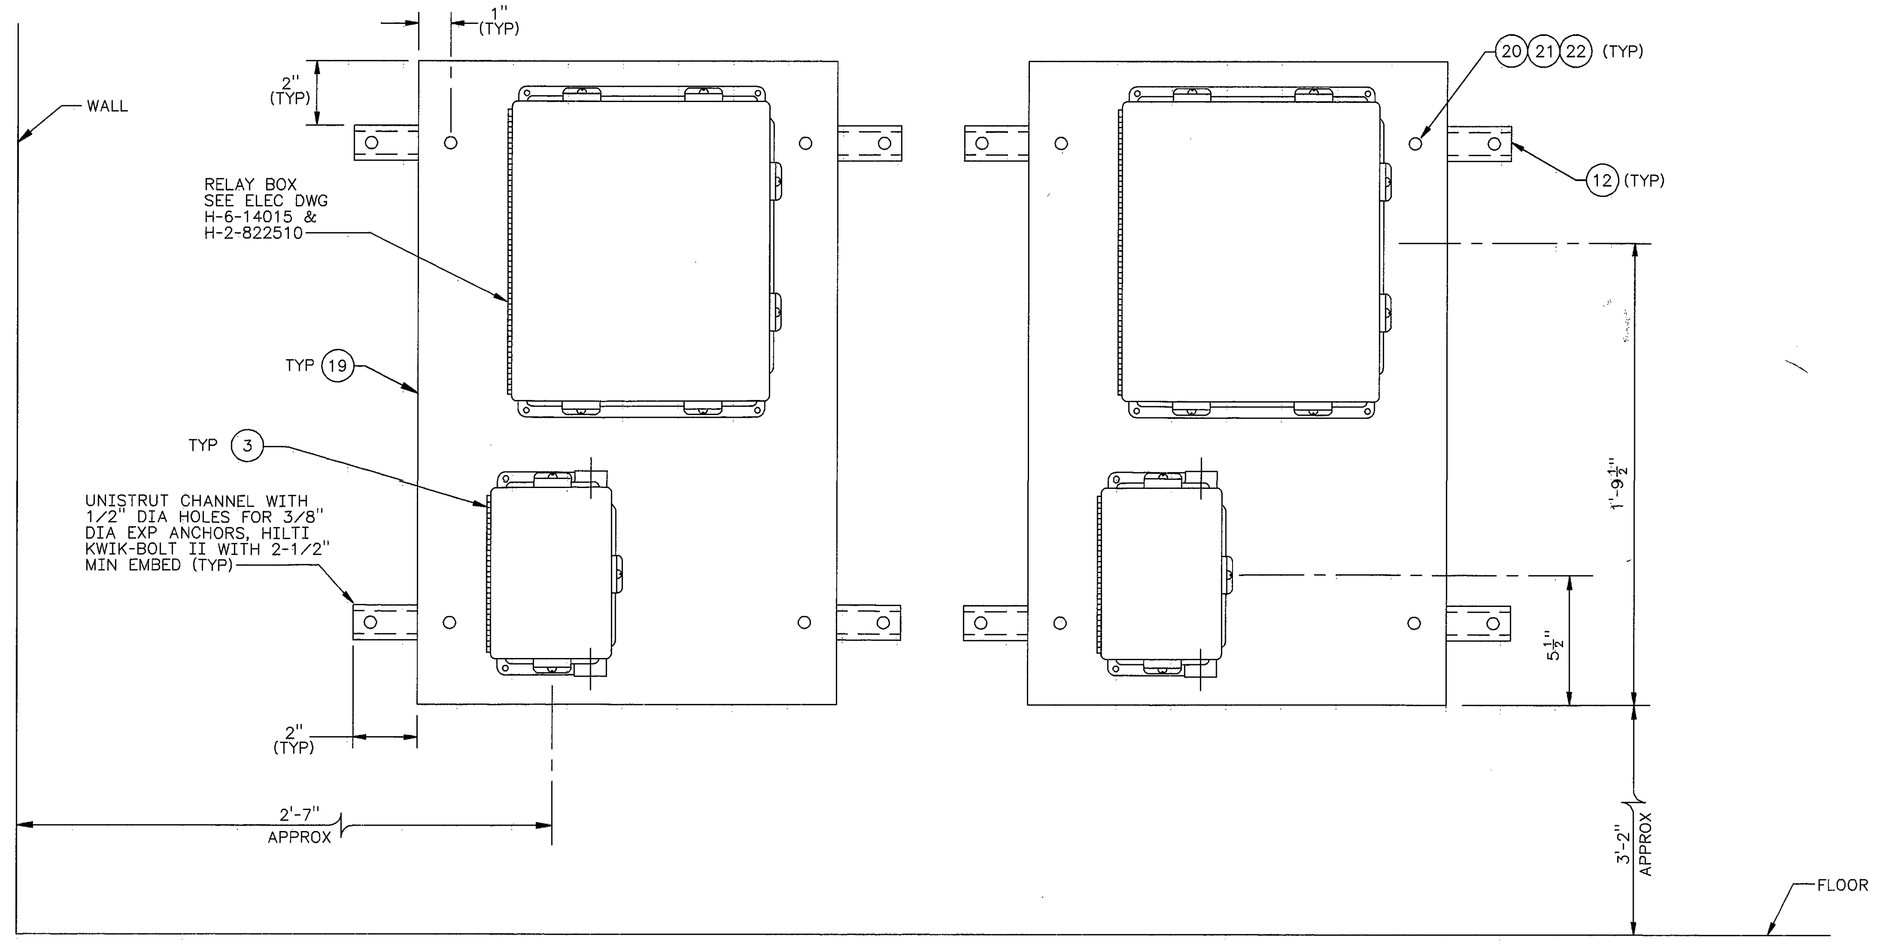

LEAK DETECTION PANEL

SCALE: NONE

LDK-3151 AND 3151A (SEE H-6-13994, SH 2)
LDK-3150 AND 3150A (SEE H-2-822336, SH 2)

MARK L. FRIEDRICH
STATE OF WASHINGTON
32426
REGISTERED PROFESSIONAL ENGINEER
3-29-98
EXPIRES: 8/31/98

DESIGNED	CL CLOUD	DATE	
DSGN ENGR	MA FRIEDRICH	9-27 1995	
CHECKED	CT INAMINE	9-27 1995	
SAFETY	SEE DR/AT FORM		
ENVIR	SEE DR/AT FORM		
QUAL ENGR	SEE DR/AT FORM		
LEAD ENGR	MA FRIEDRICH	9-27 1995	
REVIEW NO.	1	12-18 1995	
APPROVED FOR IMPLEMENTATION BY	C VAN KATWIJK		
FOR	WHC	DATE	10-13-95

SAFETY CLASS 3 — USE CONSTRUCTION — EDT 612958

U.S. DEPARTMENT OF ENERGY
RICHLAND OPERATIONS OFFICE
ICF KAISER HANFORD COMPANY

INSTM
INSTALLATION DETAILS

PROJECT W058 REPLACEMENT OF CROSS SITE TRANSFER SYSTEM

SIZE	BLDG NO.	INDEX NO.	DWG NO.	REV NO.
F	6241-A 6241-V	5901	H-2-822420	4

SCALE SHOWN — JOB NO. CR1320 — SHEET 2 OF 2

MF	REV NO.	DESCRIPTION	REV BY DATE	KEH APPROVALS	APVD FOR IMPL/INC FOR DATE
S	4	INCORPORATED ECN W058-379 W-058 PROJECT TURNOVER	HBM 3-13 1998	3/31/98 MAF 3-29-98	4/2/98

REVISIONS

NUMBER	TITLE	NUMBER	TITLE
DRAWING TRACEABILITY LIST		REFERENCES	
		NEXT USED ON	

CAD FILE B822420B — CAD CODE 2J:IBM:ACD2:12.0:NN — XREFS N

PLOT SCALE: 1=1 — KEHCAD

KEH 0350.00 (03/94) STRTKENF: 19940303.0900