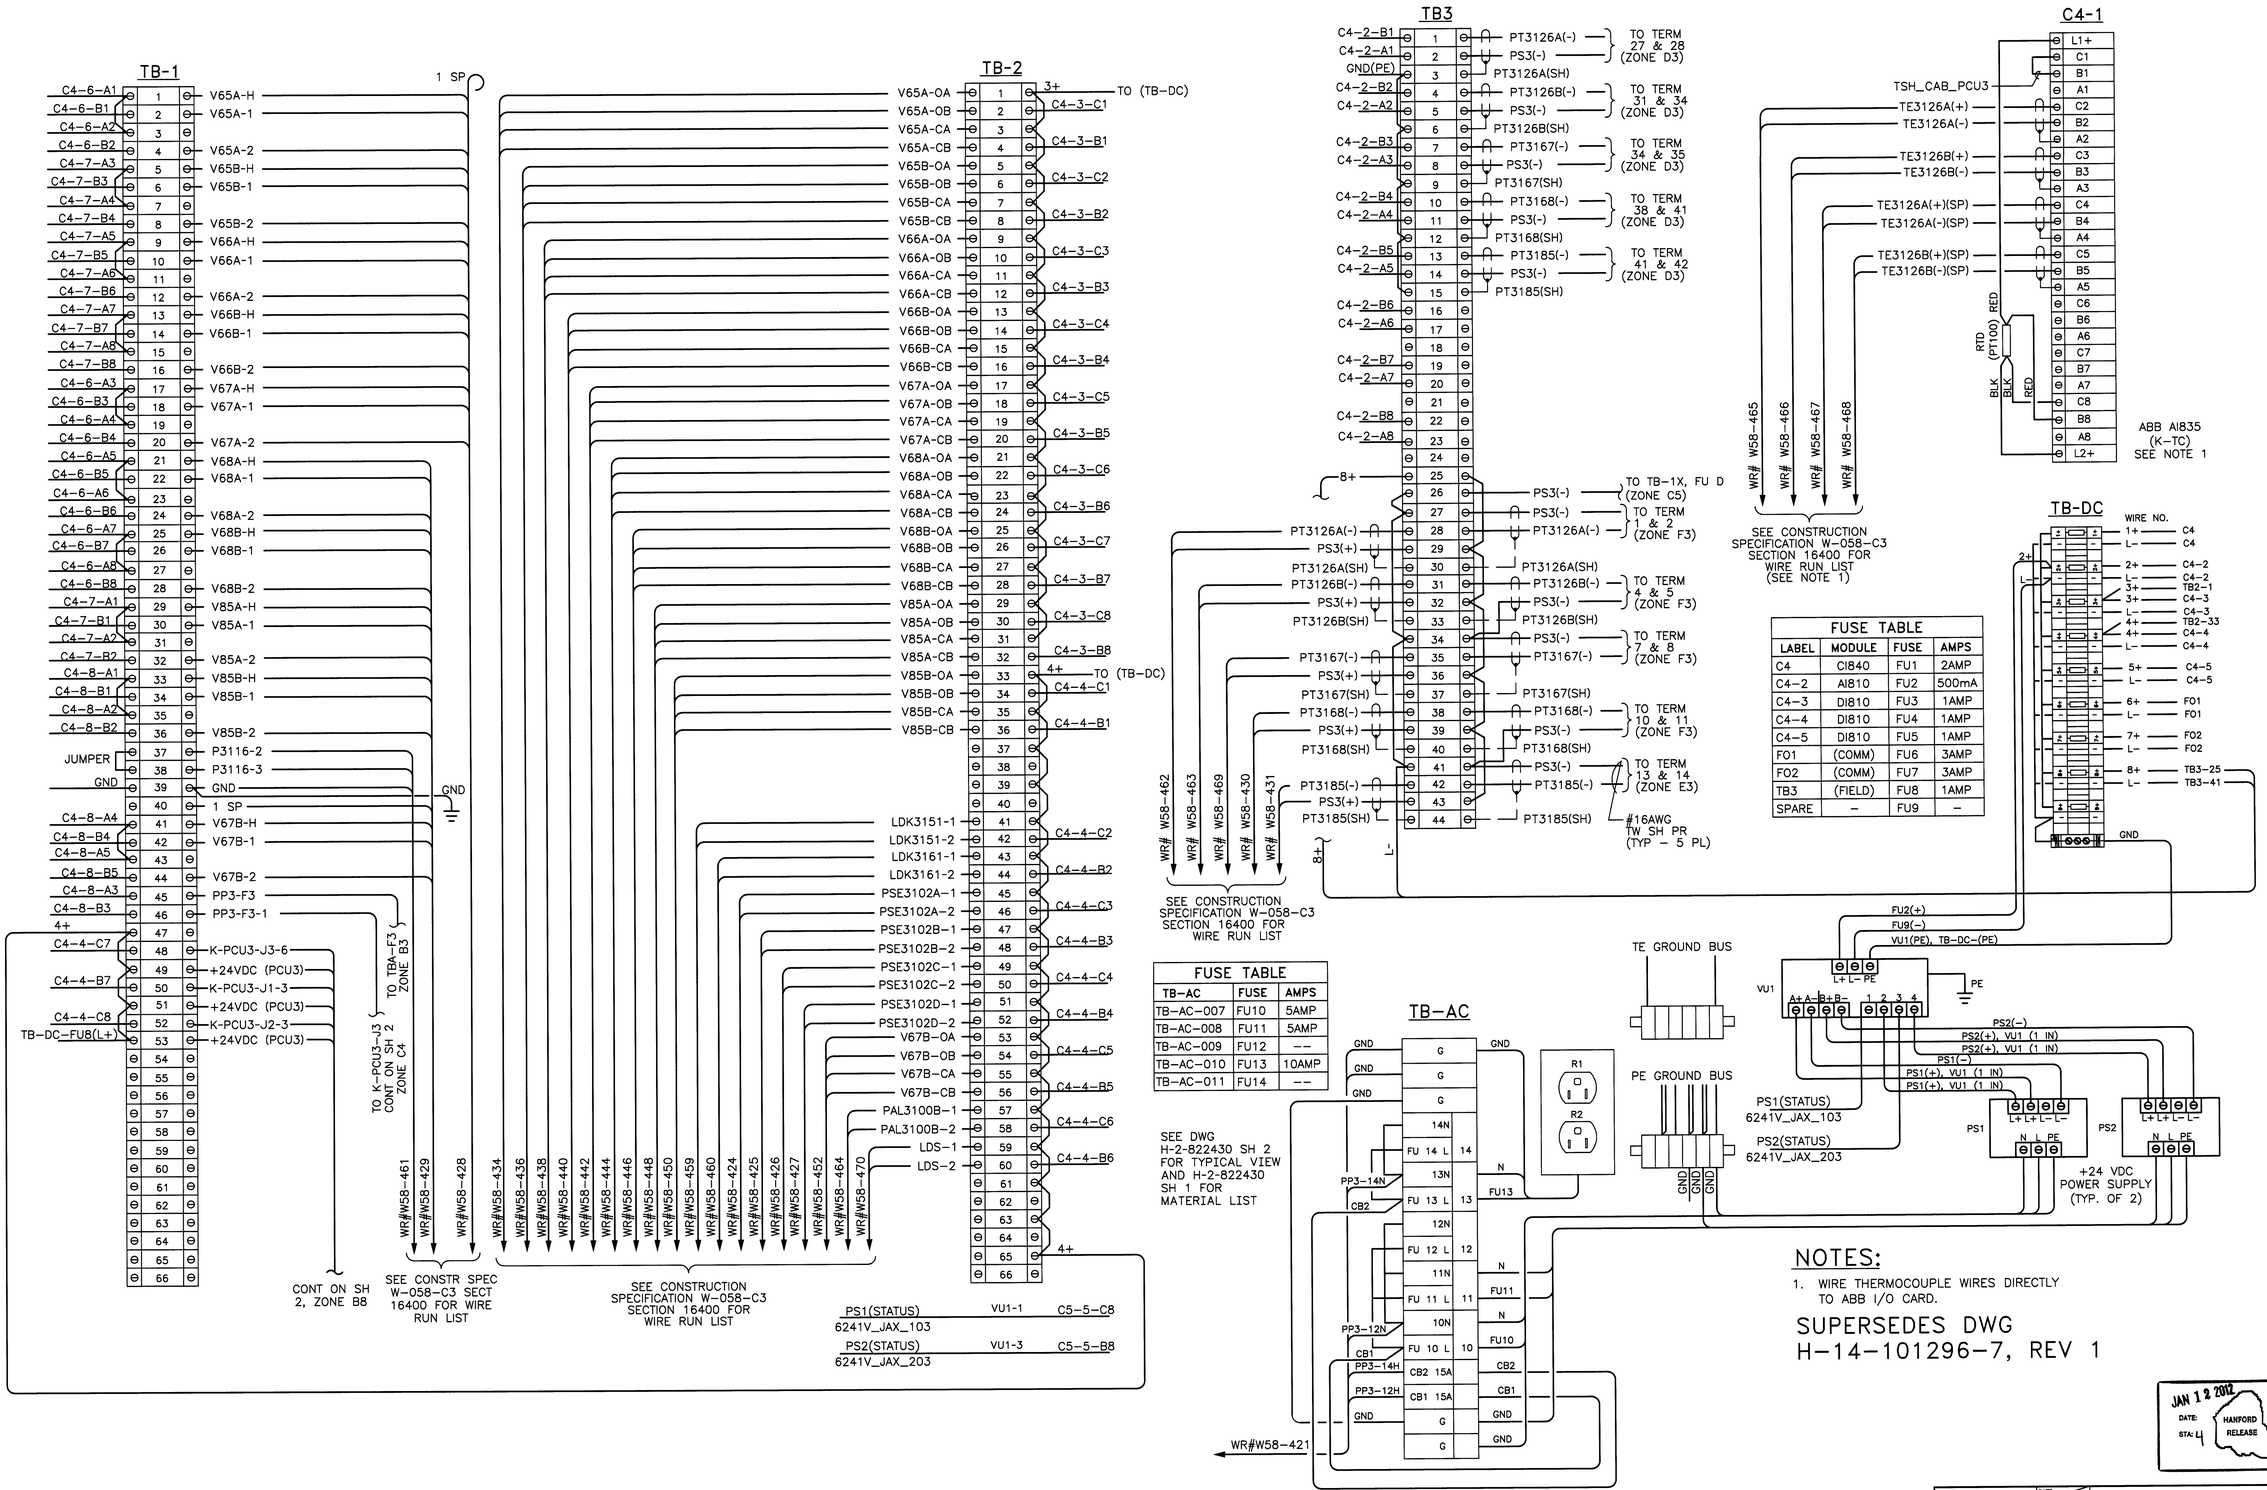


| FUSE TABLE | | | |
|---|---|---|---|
| LABEL | MODULE | FUSE | AMPS |
| C4 | CI840 | FU1 | 2AMP |
| C4-2 | AI810 | FU2 | 500mA |
| C4-3 | DI810 | FU3 | 1AMP |
| C4-4 | DI810 | FU4 | 1AMP |
| C4-5 | DI810 | FU5 | 1AMP |
| FO1 | (COMM) | FU6 | 3AMP |
| FO2 | (COMM) | FU7 | 3AMP |
| TB3 | (FIELD) | FU8 | 1AMP |
| SPARE | – | FU9 | – |

| FUSE TABLE | | |
|---|---|---|
| TB-AC | FUSE | AMPS |
| TB-AC-007 | FU10 | 5AMP |
| TB-AC-008 | FU11 | 5AMP |
| TB-AC-009 | FU12 | -- |
| TB-AC-010 | FU13 | 10AMP |
| TB-AC-011 | FU14 | -- |

## NOTES:

1. WIRE THERMOCOUPLE WIRES DIRECTLY TO ABB I/O CARD.

SUPERSEDES DWG H-14-101296-7, REV 1

JAN 12 2012 DATE: STA: 4 HANFORD RELEASE ID: 17

| DWG NO | TITLE | REF NUMBER | TITLE |
|---|---|---|---|
| DRAWING TRACEABILITY LIST | | REFERENCES | |
| | | NEXT USED ON | |

| REV NO | DESCRIPTION | REV BY DATE | DRAFTING APRVD | ENGR COMPANY |
|---|---|---|---|---|
| 9 | INC ECN-11-000428 AND DIRECT REV PER ECN-11-001346 | MAC 11/11 | RN KYLE | DT HEIMBERGER WRPS |

REVISIONS

NAME / DATE / COMPANY — DRAWN BY — SEE REVISION 0 — ENGINEER

U.S. DEPARTMENT OF ENERGY
Office of River Protection

INSTRUMENTATION TERMINATION DIAGRAM PCU-3

SIZE F | BLDG NO 6241V | INDEX NO 7502 | DWG NO H-2-822432 | REV 9

SCALE NONE | EDT | SHEET 1 OF 3

3296 | DOE_TB_F.DWG (01-01)

DWG NO H-2-822432 | SH 1 OF 3 | REV 9