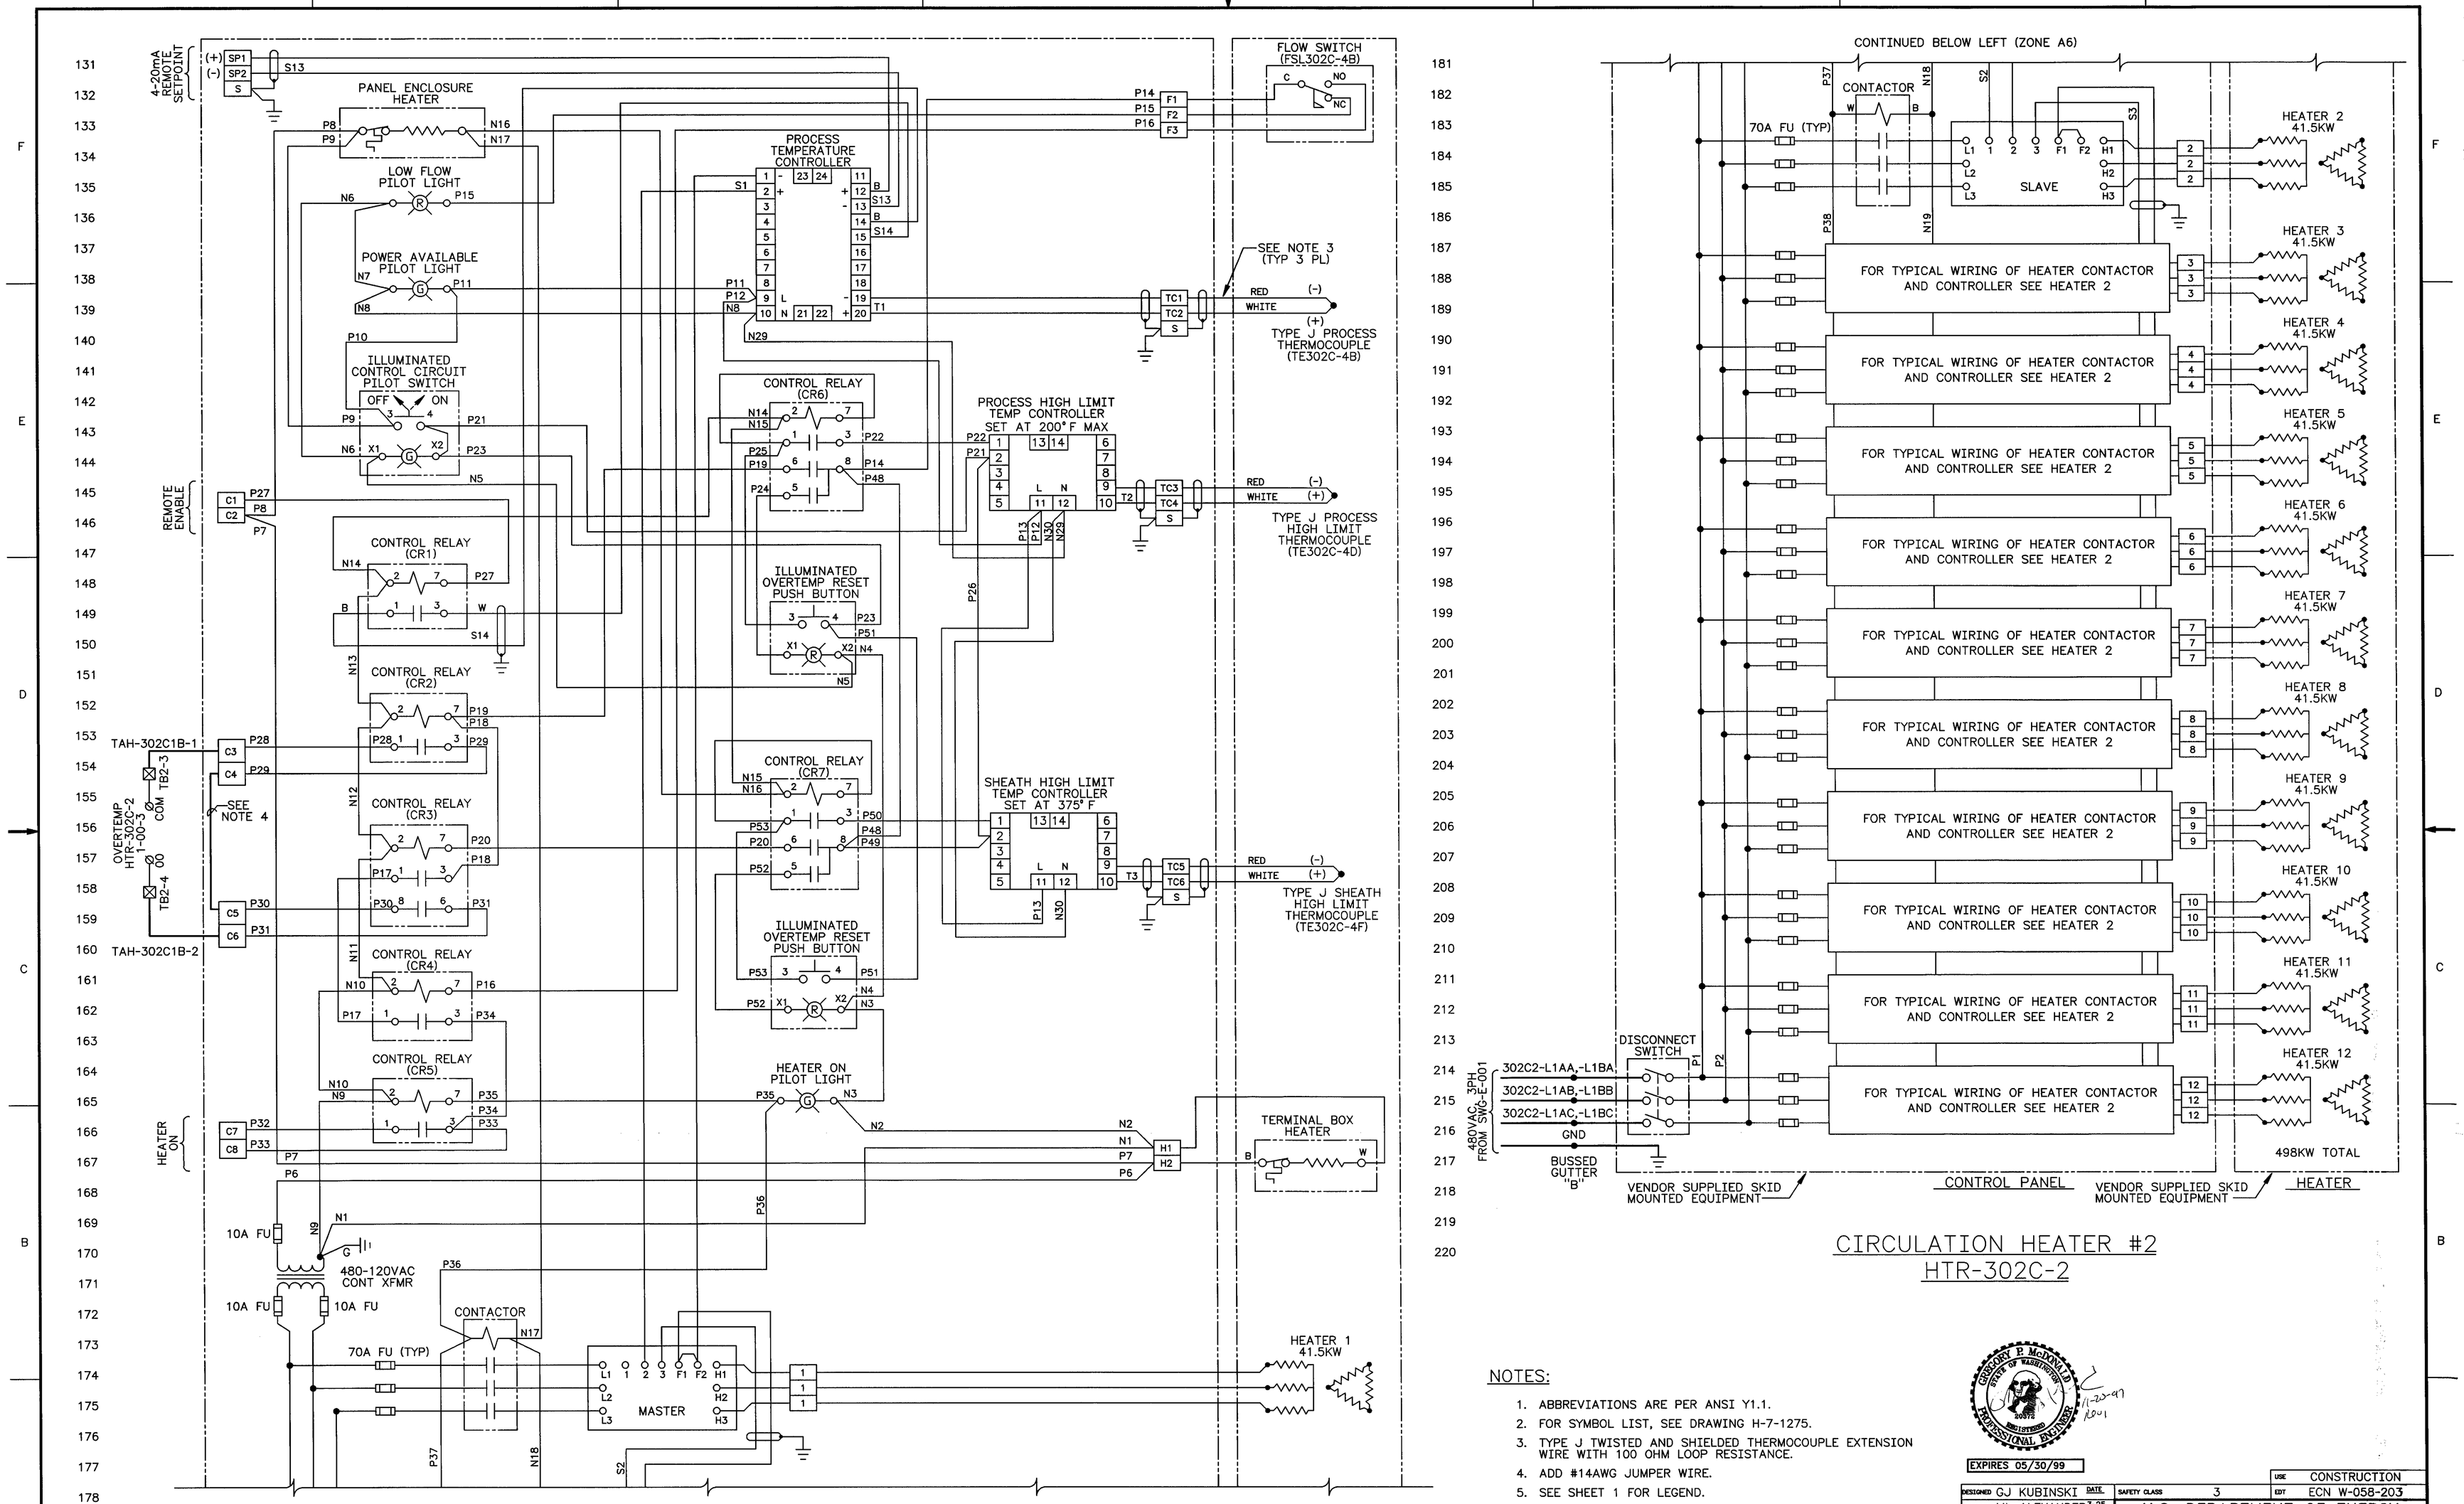


CIRCULATION HEATER #2
HTR-302C-2

NOTES:

1. ABBREVIATIONS ARE PER ANSI Y1.1.
2. FOR SYMBOL LIST, SEE DRAWING H-7-1275.
3. TYPE J TWISTED AND SHIELDED THERMOCOUPLE EXTENSION WIRE WITH 100 OHM LOOP RESISTANCE.
4. ADD #14AWG JUMPER WIRE.
5. SEE SHEET 1 FOR LEGEND.

GREGORY P. McDONALD, STATE OF WASHINGTON, 20372, REGISTERED PROFESSIONAL ENGINEER — 11-20-97

EXPIRES 05/30/99

| | | | |
|---|---|---|---|
| DESIGNED GJ KUBINSKI | DATE | SAFETY CLASS 3 | USE CONSTRUCTION |
| DSGN ENGR ML ALEXANDER | 3-25 1997 | | EDT ECN W-058-203 |
| CHECKED CT INAMINE | 3-25 1997 | U.S. DEPARTMENT OF ENERGY RICHLAND OPERATIONS OFFICE ICF KAISER HANFORD COMPANY | |
| SAFETY SEE DR/AT FORM | | | |
| ENVIR SEE DR/AT FORM | | M ELECTRICAL ELEMENTARY DIAGRAMS FLUSH SYSTEM | |
| QUAL ENGR SEE DR/AT FORM | | | |
| LEAD ENGR ML ALEXANDER | 3-25 1997 | | |
| REVIEW NO. 0 | 2-20 1997 | PROJECT W058, REPLACEMENT OF CROSS-SITE TRANSFER SYSTEM | |
| APPROVED FOR IMPLEMENTATION BY C VAN KATWIJK FOR WHC DATE 4-2-97 | | SIZE F · BLDG NO. 242-S · INDEX NO. 7502 · DWG NO. H-2-822502 · REV NO. 1 | |
| | | SCALE NONE · JOB NO. CR1320 · SHEET 3 OF 4 | |

| MF | REV NO. | DESCRIPTION | REV BY DATE | KEH APPROVALS | APVD FOR IMPL/INC FOR DATE |
|---|---|---|---|---|---|
| MS | 1 | PER ECN W-058-361 W-058 PROJECT TURNOVER | CLC 7-24 1997 | MLS | 11/21/97 |

REVISIONS

CAD FILE B822502C · CAD CODE 2J:IBM:ACD2:12.0:NN · XREF'S N

DRAWING TRACEABILITY LIST: NUMBER · TITLE

NEXT USED ON: NUMBER · TITLE · REFERENCES

PLOT SCALE: 1=1 · KEHCAD

KEH 0350.00 (03/94) STRTKEHF: 19940303.0900