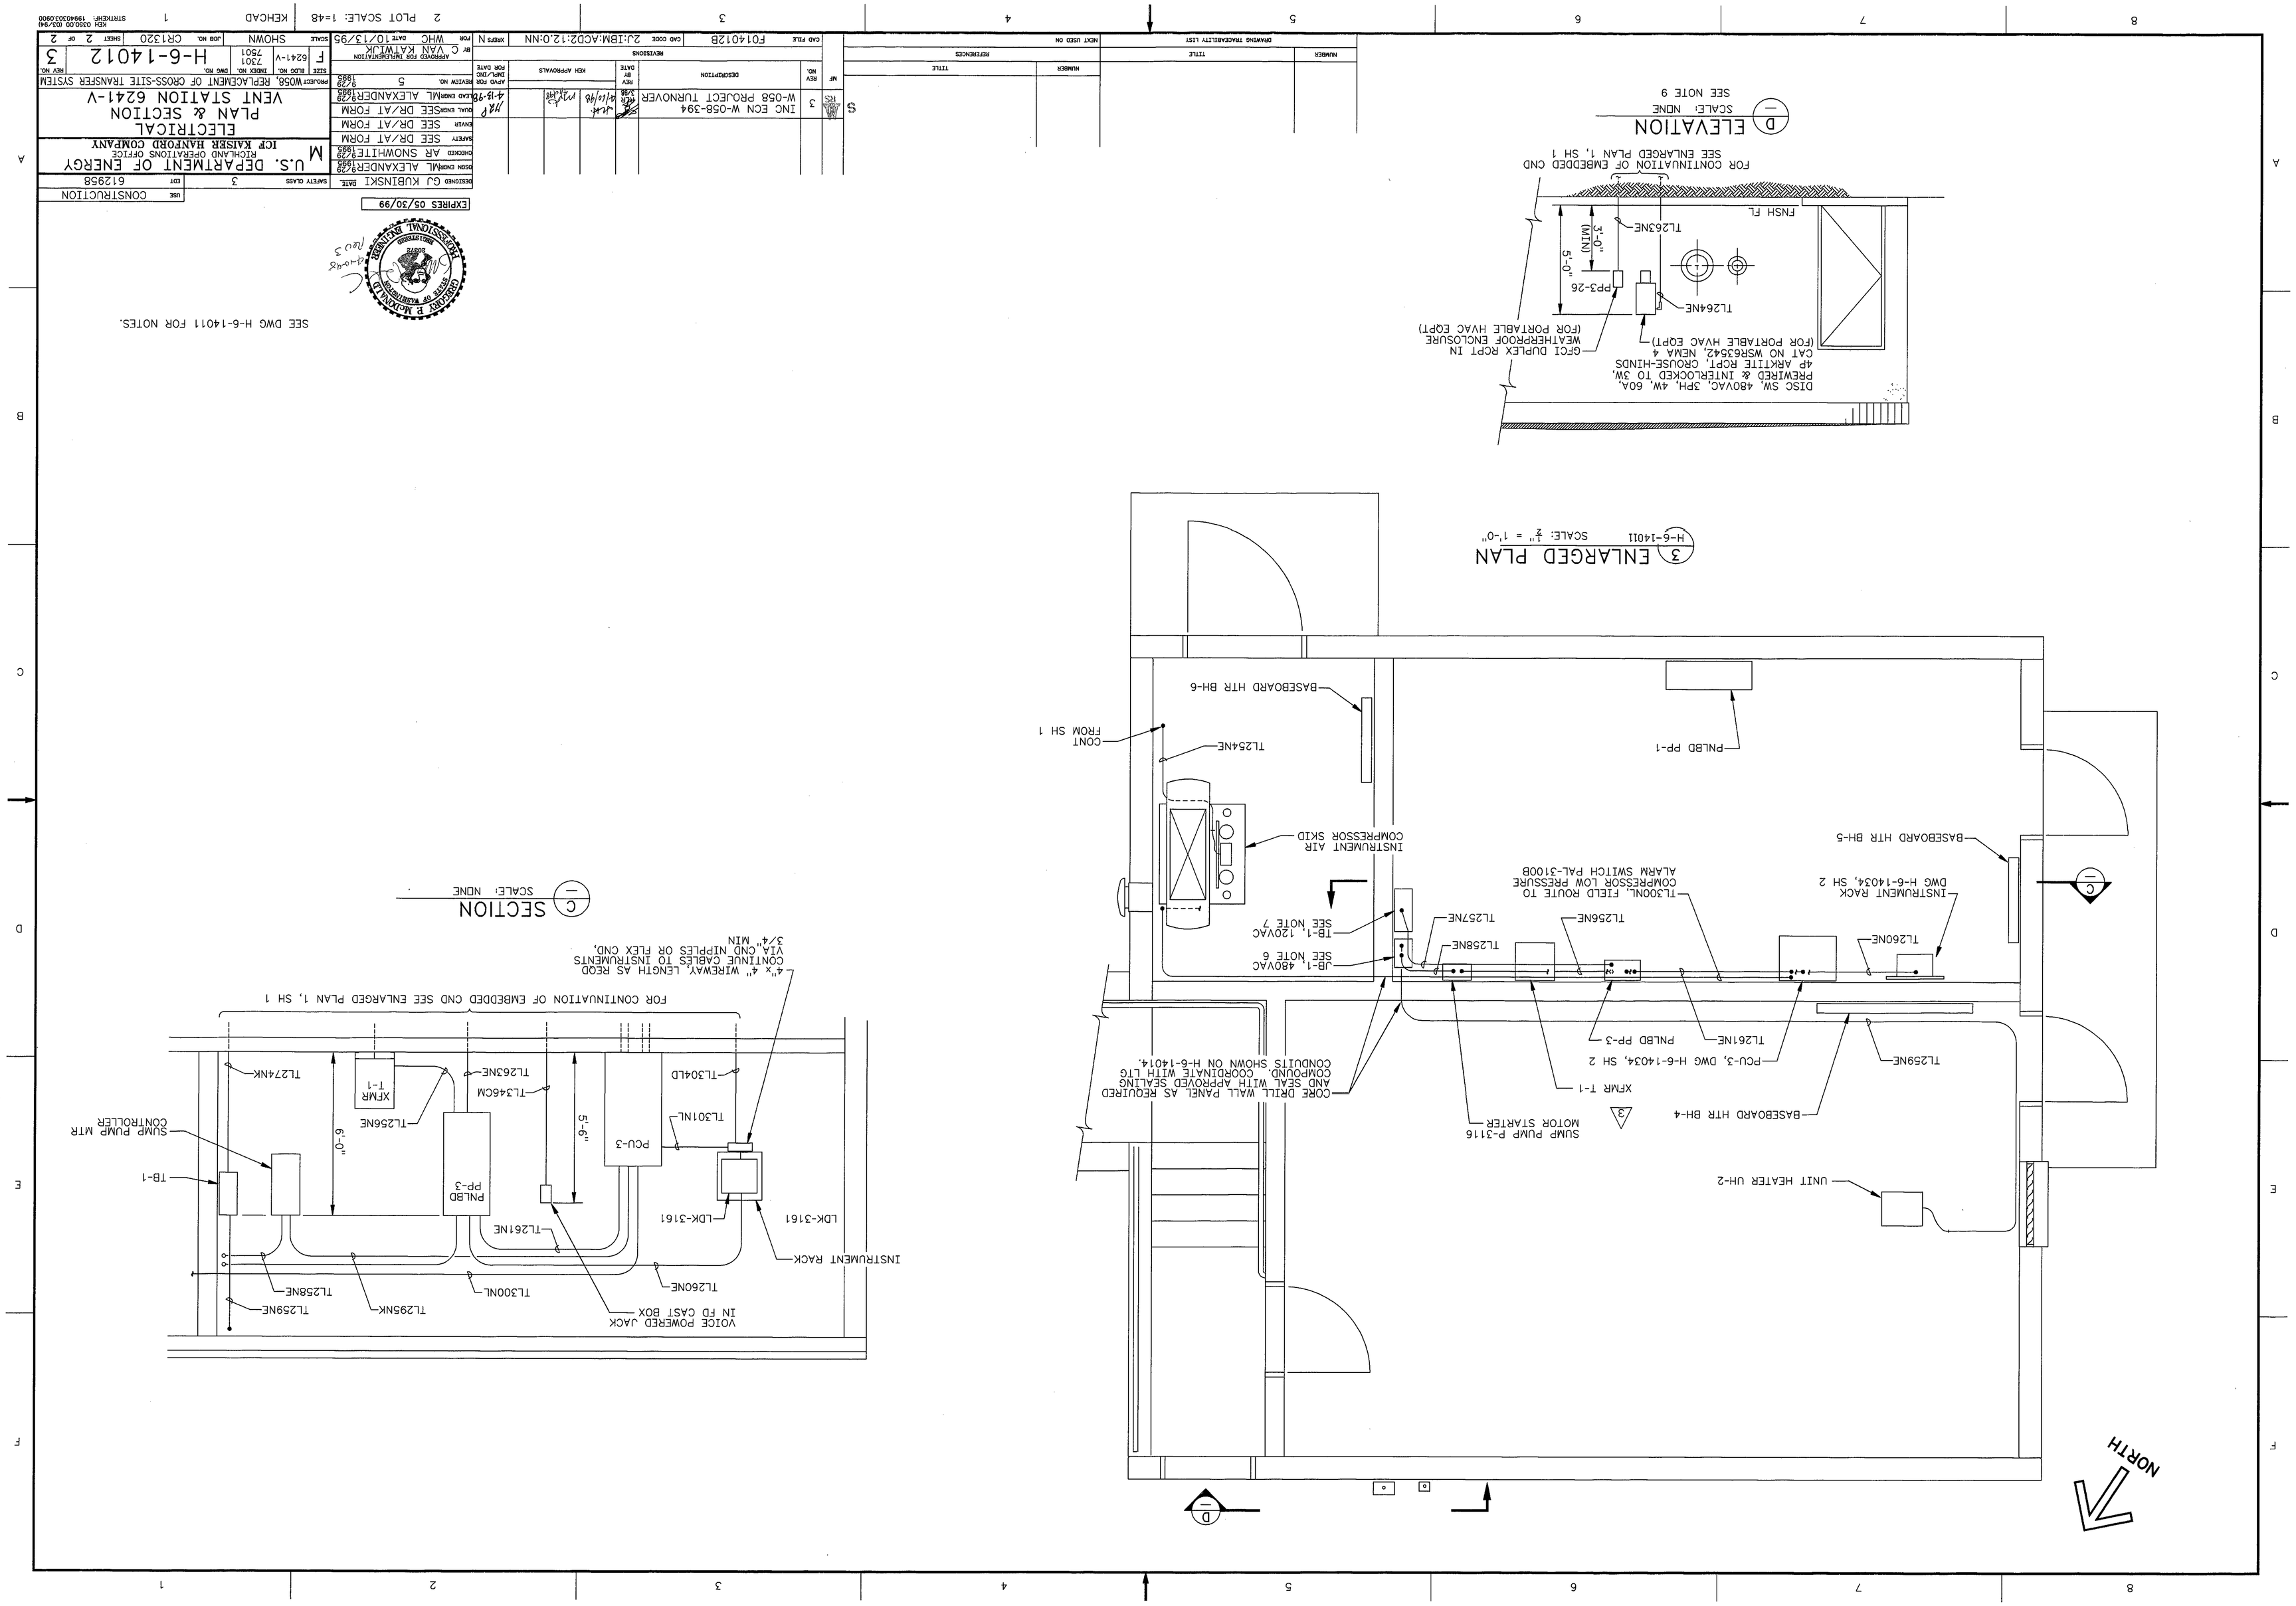

U.S. DEPARTMENT OF ENERGY
RICHLAND OPERATIONS OFFICE
ICF KAISER HANFORD COMPANY
ELECTRICAL
PLAN & SECTION
VENT STATION 6241-V
H-6-14012
3
CONSTRUCTION
612958
EXPIRES 05/30/99
INC ECN W-058-394
W-058 PROJECT TURNOVER
SEE DWG H-6-14011 FOR NOTES.
ELEVATION
SCALE: NONE
SEE NOTE 9
FOR CONTINUATION OF EMBEDDED CND SEE ENLARGED PLAN 1, SH 1
DISC SW, 480VAC, 3PH, 4W, 60A, PREWIRED & INTERLOCKED TO 3W, 4P ARKTITE RCPT, CROUSE-HINDS CAT NO WSR63542, NEMA 4 (FOR PORTABLE HVAC EQPT)
GFCI DUPLEX RCPT IN WEATHERPROOF ENCLOSURE (FOR PORTABLE HVAC EQPT)
PP3-26
TL263NE
TL264NE
FNSH FL
ENLARGED PLAN
H-6-14011
SCALE: 1/2" = 1'-0"
BASEBOARD HTR BH-6
CONT FROM SH 1
TL254NE
PNLBD PP-1
INSTRUMENT AIR COMPRESSOR SKID
BASEBOARD HTR BH-5
INSTRUMENT RACK DWG H-6-14034, SH 2
TL300NL, FIELD ROUTE TO COMPRESSOR LOW PRESSURE ALARM SWITCH PAL-3100B
TL257NE
TL256NE
TL258NE
TL260NE
TB-1, 120VAC SEE NOTE 7
JB-1, 480VAC SEE NOTE 6
CORE DRILL WALL PANEL AS REQUIRED AND SEAL WITH APPROVED SEALING COMPOUND. COORDINATE WITH LTG CONDUITS SHOWN ON H-6-14014.
PNLBD PP-3
TL261NE
PCU-3, DWG H-6-14034, SH 2
TL259NE
XFMR T-1
SUMP PUMP P-3116 MOTOR STARTER
BASEBOARD HTR BH-4
UNIT HEATER UH-2
NORTH
SECTION
SCALE: NONE
FOR CONTINUATION OF EMBEDDED CND SEE ENLARGED PLAN 1, SH 1
4"x 4" WIREWAY, LENGTH AS REQD CONTINUE CABLES TO INSTRUMENTS VIA CND NIPPLES OR FLEX CND, 3/4" MIN
TL274NK
TL263NE
TL346CM
TL304LD
TL301NL
XFMR T-1
TL256NE
PCU-3
PNLBD PP-3
SUMP PUMP MTR CONTROLLER
TB-1
TL261NE
LDK-3161
INSTRUMENT RACK
TL258NE
TL300NL
TL260NE
TL259NE
TL295NK
VOICE POWERED JACK IN FD CAST BOX